

WARRANTY INFORMATION

It is agreed that seller's liability and purchaser's sole remedy, whether in contract, under any warranty, in tort (including negligence), in strict liability or otherwise, shall not exceed the return of the amount of the purchase price paid by purchaser, and under no circumstances shall seller be liable for any special, incidental, or consequential damages, including but not limited to, property damage, damage to or loss of equipment, lost profits or revenue, costs of renting replacements and other additional expenses, even if seller has been advised of the possibility of such damages. The price stated for the product is a consideration in limiting seller's liability and purchaser's remedy.

Seller will not be liable for any damages, losses or expenses as a result of purchaser's negligence, whether deemed active or passive and whether or not any such negligence is the sole cause of any such damage, loss, or expense.

The purchaser and/or installer assents to the above limitations and terms by installing this product. If the limitations and terms are not acceptable, return at once to manufacturer in original packaging and with proof of purchase for refund of purchase price.

GOVERNING LAW AS TO RIGHTS, DUTIES AND VENUE

The parties acknowledge that the transaction that is the subject matter of this agreement bears a reasonable relation to the State of Florida and agree that in the event of any dispute or disagreement between them relating to this agreement, the law of the State of Florida shall govern their rights and duties under this agreement. The parties specifically intend that the provisions of Article 2 of the Florida Uniform Commercial Code will control as to all aspects of this agreement may expressly provide otherwise.

The purchaser and/or installer expressly submits to the jurisdiction of the State of Florida and to the jurisdiction and venue of the County Circuit Court for Volusia County at Daytona Beach, Florida and process may be served on purchaser and/or installer by mail.

ARBITRATION OF DISPUTES

All disputes that may arise between the parties regarding the interpretation or application of this contract and the legal effect of this contract shall, to the exclusion of any court of law, be arbitrated and determined by a board of arbitrators, unless the parties can resolve the dispute by mutual agreement. Either party shall have the right to submit any dispute to arbitration 90 days after the other party has been notified as to the nature of the dispute. If the dispute goes to arbitration, each party shall select one arbitrator and the two arbitrators so selected shall jointly select a third arbitrator. The arbitration shall be governed by the rules of the American Arbitration Association. The arbitration proceeding shall be governed by the statutes State of Florida, and the proceeding shall be held in the city in the state where the principle office of seller is located. Anything to the contrary contained in the above-mentioned rules and statutes notwithstanding, the parties consent that any papers, notices or process necessary or proper for the institution or continuance of, or relating to any arbitration proceeding, or for the confirmation of any award and entry of judgment on any award made, including appeals in connection with any judgment or award, may be served on each of the parties by registered mail addressed to the party at the principle office of the party, or by personal service on the party in or without the above-mentioned state. The parties recognize and consent to the above mentioned arbitration association's jurisdiction over each and every one of them.

The purchaser and/or installer assents to the above limitations and terms by installing this product. If the limitations and terms are not acceptable, return at once to manufacturer in original packaging and with proof of purchase for refund of purchase price.



MODEL F203OK Counter-Top Unit Owner's Manual & Installation Instructions



www.okeywater.com

Okey Water, LLC
PO Box 730652
Ormond Beach, FL 32173

Installation Instructions

1. Find a convenient location to place the unit on top of the counter.
2. Remove the aerator on the end of the existing faucet (if one is present) and attach the enclosed diverter valve (see diagram on next page). It may be necessary to utilize one of the alternative adapters enclosed if the faucet is not equipped with male threads.
3. Push the vinyl tubing onto the barbed shaft of the diverter valve.
4. Lead the tubing around the faucet and over to the barbed connector on the filter.
5. FOR MODEL# F203OK: Insert the spout into the spout elbow on the outlet side.
6. Turn on the cold water slowly and pull the diverter valve to the "on" position and allow the unit to fill.
7. Flush the unit for approximately 2 minutes, or until the water runs clear.

SPECIAL NOTE: *This unit is not intended for use where water is microbiologically unsafe or of unknown quality without adequate disinfection before or after the system. all installations must conform to any state and local plumbing codes/regulations.*


CHECKING FOR PROPER UNIT FUNCTIONING

The best way to determine if the unit is not functioning is by the use of your taste sense. If the bad taste of chlorine, etc, returns you know it is time to replace the unit. In addition, every three to six months you can perform a chlorine test with the use of Chlorine Test Strip available from Okey Water. Other kits can be purchased through your local pool supply store. In the case of a health related contaminate such as lead, it is recommended that a repeat testing program be instituted by a local lab on a preset, scheduled basis to verify unit performance due to many variances in the water quality.

Replacement Units

Drinking Water System	Replacement Unit
F203OK	F207OK
F220OK	F207OK
F230OK	F207OK

Diagram

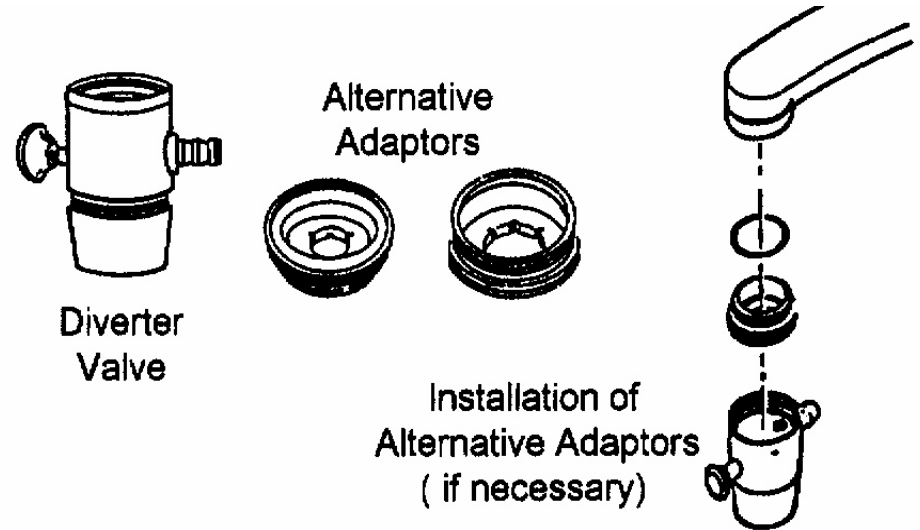

SPECIFICATIONS

	F203ok
Max Flow Rate (gpm)	1.5
Minimum Operating Pressure (psi)	20
Maximum Operating Pressure (psi)	90
Minimum Operating Temperature (F°)	35
Maximum Operating Temperature (F°)	100

SPECIAL NOTE: Pressure regulator must be used if there is a possibility of pressure exceeding recommended levels. In high-rise applications, a regulator set to 70 P.S.I. is MANDATORY.